


WU-UV Series

All-in-One Ultraviolet Filtration

RAINWATER

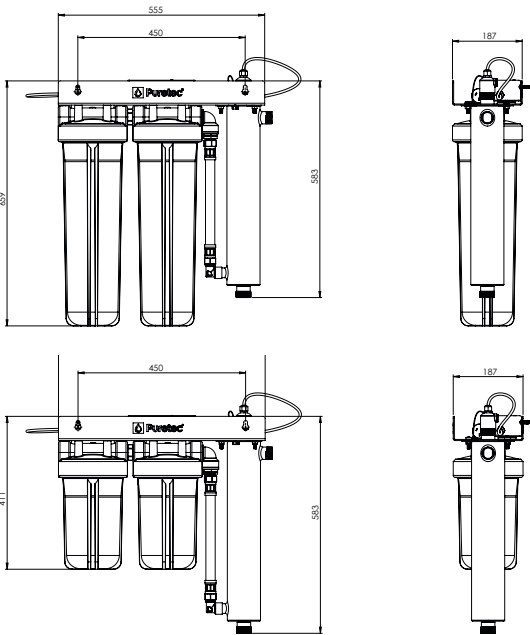

Specifications

120mm clearance needed for lamp and cartridge changes.
Note: All dimensions are in mm.

Ordering Code	Pressure** (kPa)	Max. Flow (Lpm)	Connection	Micron Rating*
WU-UV100-LF	300-520	60	1" BSP	1
WU-UV200-LF	300-520	110	1" BSP	1

Min/Max Temperature: 0-52°C. Protect from freezing.

FILTRATION TECHNOLOGY

Ordering Code	Description	Micron Rating* (Nominal)	Cartridge Size
WU-UV-100 CARTRIDGES			
PP20LD1	Sediment	20	10" MaxiPlus
MB01LD1	Polyspun Sediment	1	10" MaxiPlus
WU-UV-200 CARTRIDGES			
PP20LD2	Sediment	20	20" MaxiPlus
MB01LD2	Polyspun Sediment	1	20" MaxiPlus

REPLACEMENT PARTS

Ordering Code	Components
RL6	Replacement UV Lamp
RQ56	Replacement Quartz Sleeve
WU-UV-COVER	Weather cover to suit WU-UV systems

Warranty: Use only genuine Puretec replacement cartridges. 1 year warranty is 1 year parts and labour. Excludes cartridges.



Warning: Please visit www.puretecgroup.com/instructions to observe essential manufacturer's instructions before use. **Note:** No claims can be made based on the specifications and images in this document. The design, technology, colours, features and prices are subject to change. This document and all its contents are copyright protected. All rights are reserved, particularly alteration, translation and reproduction using electronic systems. This spec sheet has been designed to help make product selection easy. However due to the complex nature of water chemistry, we strongly encourage confirming any product selection with one of our team. We may need to perform a water analysis test to confirm contaminants in water. **Caution:** Do not use with microbiologically unsafe water or water of unknown quality without adequate disinfection before or after the system. **Warranty:** *Warranties in this document cover parts for the period stated and include cover for parts and labour for the first year where applicable, subject to approval. Excludes consumables. *Micron Rating is nominal. Our Water Filtration Specialists can provide you with advice to suit your needs. **Where line pressure exceeds 520kPa, an approved pressure limiting device must be installed to comply with Australian & New Zealand Plumbing Standards (Ref. AS 35001:2021, Clause 3.3.4). Maximum flow depends on cartridges, vessel, pressure, impurities etc.

Parts Included



WU-UV-100




User guide



PP20LD1
Sediment



MB01LD1
Polyspun Sediment

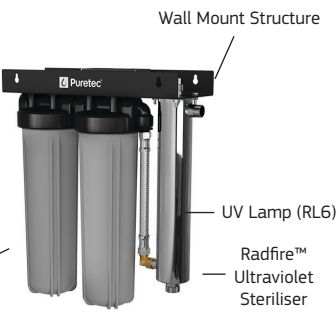

WU-UV-200



PP20LD2
Sediment



MB01LD2
Polyspun Sediment

MAY 2026

For more information contact your local stockist or visit us at puretecgroup.com
Australia **1300 140 140** | New Zealand **0800 130 140**

For full details & specs, refer to the user guide.

